


2011-10-18 Tangleflags 11-17-05/-26W3

①

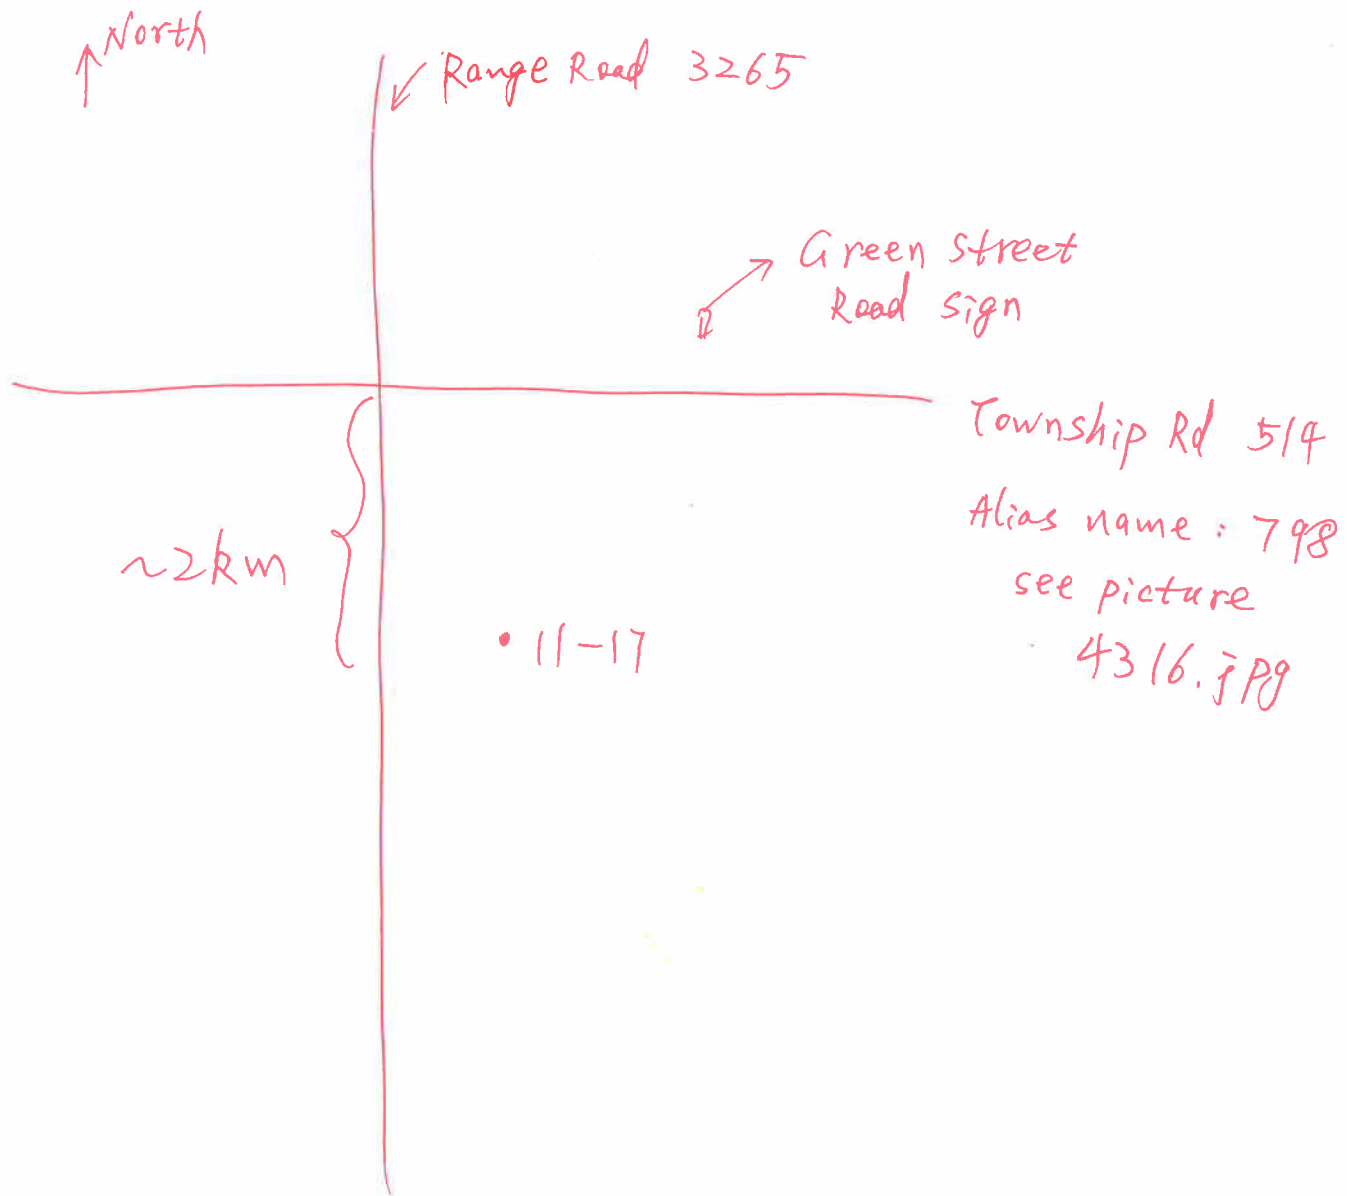

② site transformer 300kVA, 24940-480VAC
Year: Dec 2009. PTI: Regina.

③ MCC. square D. Model 6